FORCE 50 and INTEG 50 Robotic Nozzle system

Generic installation and Setup manual



WARNINGS

WARNING	READ this instruction manual in its entirety prior to installing, maintaining, or using the Unifire Force™ ROBOTIC NOZZLE (AKA "Robotic nozzle" or "CAN- NON"). Failure by any installer, maintenance personnel or operator to receive proper training, including reading and understanding this manual, prior to its use constitutes misuse of the equipment and could result in serious bodily injury or death and/or damage to the robotic nozzle or other property. Only qualified and trained professionals who are famil- iar with this equipment and general safety procedures may operate the Force robotic nozzle. The purpose of this Manual is to provide all users, installers, and maintenance person- nel with the relevant information concerning the design, proper use, installation and maintenance of the equipment and should be read and made available to all such per- sons. This Manual will help prevent danger and injury to you and others. If you would like further copies of this manual, ask Unifire or download it at www.unifire.com. If you have any questions relating to this equipment and its safe use please contact Unifire prior to use at: Support@unifire.com
WARNING	DO NOT ATTEMPT TO MODIFY THIS EQUIPMENT IN ANY WAY. Modification of the equipment may result in damage to, or malfunction of, the equipment, which could lead to serious injury of the operator and/or others. Internal inspection, maintenance and repairs should only be performed by, or under the specific, express authority of Unifire AB.
WARNING	NEVER POINT THE FORCE 50 OR ANY Robotic nozzle DIRECTLY AT HUMANS WHILE WATER IS SPRAYING THROUGH IT, as doing so can result in serious injury or possibly death. The FORCE 50 is capable of directing flows of up to approximately 2000 liters per minute (540 gallons per minute) at pressures of up to 12 bars (175 psi) and has a maximum throwing range of up to approximately 65 meters (70 yards). Such forces are very dangerous and capable of producing serious injury or death to persons and serious damage to property. They are also capable of throwing objects with ex- treme force and velocity into other objects or persons. Accordingly, only professional, trained firefighters or other qualified individuals may operate this equipment after being thoroughly familiar with the Manual, and always by exercising extreme caution to avoid hitting people or lose objects with the water (or other fluid) stream.
	BE SURE THAT THE ROBOTIC NOZZLE IS TIGHTLY AND PROPERLY SECURED AT ALL TIMES DURING OPERATION! Serious injury or death can occur if the robotic nozzle is not fully and properly secured and supported. Be sure that the mounting pipe for the FORCE 50 robotic nozzle is capable of withstanding a nozzle reaction force of at least eight thousand (8,000) Newtons (800 kgf). The FORCE 50 robotic nozzle should not be used on a portable stand of any kind, as such use can be extremely dangerous and can result in Serious Injury or Death.

	The FORCE 50 IS HEAVY. Use caution and assistance when installing and take care to avoid injury to your back. Seek assistance to help support and twist the robotic nozzle during installation and take care to avoid injury to your back during handling and installation.
WARNING	NEVER USE THE ROBOTIC NOZZLE AT PRESSURES HIGHER THAN 12 BARS (175 PSI). The maximum operating pressure for the FORCE 50 robotic nozzle is 12 bars (175 psi). Use of the FORCE 50 at pressures higher than 12 bars is dangerous and can lead to serious injury or death or may damage the robotic nozzle. Moreover, the recommended operating pressure of the FORCE 50 is between 7 and 8 bars (100 and 115 psi), which also will provide optimal performance.
A WARNING	ONLY MOUNT THE FORCE Robotic nozzle SO THAT ITS BASE IS PERPENDICU- LAR TO THE GROUND. DO NOT install the robotic nozzle at an angle or upside-down without the specific prior written consent of Unifire AB. Doing so may cause damage to the robotic nozzle gears and motors, which could lead to malfunction.
	FOLLOW ALL MAINTENANCE & INSPECTION PROCEDURES in this manual.
WARNING	Be sure to use the proper type and size of threads at the robotic nozzle base and also between the robotic nozzle and nozzle (if using a nozzle not supplied by Unifire specifically for use with this robotic nozzle). Use of the wrong type or size of threads will result in an improper connection which can cause leaking and also may cause the robotic nozzle and/or nozzle to dislodge under high pressure, possibly leading to serious injury or death to persons and/or serious damage to property. If you have any doubts as to the exact thread supplied by Unifire, contact Unifire for clarification prior to connecting the robotic nozzle and nozzle.
	KEEP A SAFE DISTANCE DURING OPERATION AND MOVEMENT. The FORCE 50 Robotic nozzle has moving parts. Be sure to keep a safe distance from the robotic nozzle as it moves and keep hands and fingers away from pinch points to avoid injury.
	AVOID RAPID CHARGING . Rapid charging of the robotic nozzle is potentially danger- ous and can cause serious injury to persons and/or property and may cause damage to the robotic nozzle. Charge the robotic nozzle slowly to avoid creating a potentially dangerous, high-pressure surge.

WARNING	USE ONLY UNIFIRE-APPROVED NOZZLES / NOZZLE TIPS. The FORCE 50 was designed for use with the Unifire INTEG 50 and Unifire Smooth Bore nozzles. Use of any nozzle other than a Unifire nozzle made for the FORCE 50 without specific, written approval in advance by Unifire AB constitutes misuse of the product and could affect the safety, performance and/or operation of the robotic nozzle. Such malfunctions could also result in the nozzle coming loose and being rapidly ejected with high force, which could cause serious injury or even death.
WARNING	DO NOT OPERATE IN EXPLOSIVE ZONES OR ENVIRONMENTS! The electric motors and other components are potential ignition sources and could spark ignition if used in explosive environments. The FORCE 50 is not approved for operation in explosive environments and therefore it should never be used in such environments.
WARNING	DO NOT IMMERSE EQUIPMENT IN WATER . Do not immerse the robotic nozzle, its control box (the TARGA PLC) nor the joystick in water and be sure to keep water out of their interiors. Unifire's robotic nozzles, and joystick are designed to withstand moderate exposure to rain and water splashing during normal use of the robotic nozzle. Prolonged or extreme exposure to water, including submersion, however, will cause damage and could also cause electrical shock resulting in injury. The TARGA PLC must be installed protected form water and dust. IP67 rated enclosure is optional.
WARNING	Do not use the electrical controls during operation of the emergency manual override cranks as doing so could cause injury.
WARNING	ONLY USE THE MANUAL OVERRIDE IN CASE OF TRUE EMERGENCY & POWER FAILURE. The manual override controls on the FORCE 50 are not designed for normal operation and should only be used in the case of extreme emergency and when the re- mote control feature is not working sufficiently to control the robotic nozzle by means of the electronic controls. In case of use in such an emergency, first disconnect the cables from the motor connections. !!
WARNING	DISCONNECT POWER PRIOR TO INSTALLATION, MAINTENANCE OR REPAIR. Prior to installation, maintenance or repair be sure to disconnect power and disable flow.

WARNING	Be sure to use the proper type and size of threads at the robotic nozzle base and also between the robotic nozzle and nozzle (if using a nozzle not supplied by Unifire specifi- cally for use with this robotic nozzle). Use of the wrong type or size of threads will result in an improper connection which can cause leaking and also may cause the robotic nozzle and/or nozzle to dislodge under high pressure, possibly leading to serious injury or death to persons and/or serious damage to property. If you have any doubts as to the exact thread supplied by Unifire, contact Unifire for clarification prior to connecting the robotic nozzle and nozzle.
	The FORCE 50 is heavy. EXERCISE caution and SEEK assistance when installing and take care to avoid injury to your back. Seek assistance to help support and twist the robotic nozzle during installation and take care to avoid injury to your back during handling and installation.
WARNING	BE SURE THAT THE FORCE 50 IS TIGHTLY AND PROPERLY SECURED AT ALL TIMES DURING OPERATION! Serious injury or death can occur if the robotic nozzle is not fully and properly secured and supported. Be sure that the mounting pipe for the FORCE 50 is capable of withstanding a nozzle reaction force of at least eight thousand (8,000) Newtons (800 kgf). The FORCE 50 robotic nozzle should not be used on a portable stand of any kind, as such use can be extremely dangerous and can result in Serious Injury or Death.
WARNING	NORMALLLY MOUNT THE FORCE Robotic nozzle SO THAT ITS BASE IS PERPEN- DICULAR TO THE GROUND. If you plan to install the robotic nozzle at an angle or upside-down, please consult UNI- FIRE when ordering. Special gear ratio and programming may be required.

INTRODUCTION to this Manual







UNIFIRE FORCE 50 system

This installation and setup manual is intended to provide generic guidance for installation and commissioning of the UNIFIRE FORCE 50 system, including the TARGA Robotic Nozzle PLC and the Ammolite User Interface,

Your system is delivered with user specific functions that can be different than what is described in this manual. Therefore it is important that you reference the order-specific documents provided with the delivery.

This can include custom I/O. terminal socket specification, M12 pin-specifications and special customer specific software.

For further info please see Unifire Robotic Nozzle catalogue And visit our websites: www.unifire.com www.roboticnozzles.com www.automaticfirefighting.com and www.youtube.com/unifireab

Also refer to the system specific documentation

ACRONYM DEFINITIONS

Table 1 defines the acronyms in the user manual.

TABLE 1: ACRONYM DEFINITIONS

Acronym	Definition
AFS	Autonomous fire suppression
AHJ	Authority having jurisdiction
DSP	Digital signal processor
dm	Decimeter
ft	Foot (or Feet)
FACP	Fire alarm control panel
HR	Horizontal range
IR	Infrared
kg	Kilogram
lb (lbs)	Pound(s)
m	Meter
mm	Millimeter
Lpm	Liters per minute
PLC	Programmable logic controller
VDC	Volts of direct current



TABLE OF CONTENTS

WARNINGS	
INTRODUCTION TO THIS MANUAL ACRONYM DEFINITIONS	2-2
PLANNING - BEFORE INSTALLATION	
About This Manual	3-2
Contacts	3-2
APPROVALS AND STANDARDS	3-2
SAFETY warnings	3-2
Authorized Personnel	3-2
Structural Alterations	3-2
System Limitations	3-4
Building Construction Determining a Location	3-4 3-4
Water connection	3-4 3-4
MECHANICAL INSTALLATION	
INSTALLATION GEOMETRY OPTIONS	4-1
Wall, normal orientation	4-1
Wall, inverted orientation	4-2
Ceiling, hanging orientation	4-3
Installation on the wall	4-4
Installation hanging from the ceiling	4-4
Installing The Robotic Nozzle	4-5
FLOW SETTINGS	
Nozzle Flow Setting	5-1
Flow chart	5-2
Reach chart	5-3
ELECTRICAL INSTALLATION	
Generic system overview	6-1
Connecting the FORCE 50 to the TARGA PLC	6-2
TARGA PLC generic pin-specification	6-3
TARGA Robotic Nozzle PLC TERMINAL SOCKETS	6-4
GENERIC TERMINAL SOCKET SPECIFICATION	6-4
SOFTWARE & CALIBRATION	
Calibrating the Robotic Nozzle's operating range	7-1
Ammolite Software Introduction	7-3
Connect your PC or TABLET	7-4
TECHNICAL SPECIFICATIONS SYSTEM COMPONEN	TS
FORCE 50 QUICK SPECIFICATIONS	8-1
TARGA™ PLC SPECIFICATIONS	8-3
TARGA PLC DIMENSIONS	8-4
X-TARGA™ & X-TARGA-S	8-5
Unifire TARGA PCB TARGA PCB	8-7 8-7
Unifire Web Server	8-7 8-9
CAN Bus Cape	8-11
BLDC Driver Card	8-12
ONE Graphical User Interface	8-13
π™ (Pi) CAN bus Joystick	8-15
POINTER™ Synchron Joystick	8-16
BLDC Motors	8-17
FORCE 50 SPARE PARTS	8-18
Custom Solutions	8-19

PLANNING - BEFORE INSTALLATION

About This Manual

This manual is a comprehensive guide that contains the information necessary to design, install, operate, and maintain the FORCE 50 Robotic Nozzle system.

Users of this manual are assumed to be competent fire engineers with a basic knowledge of such systems. Users who are not familiar with the equipment should first read the complete manual.

Only certified personal who have undergone UNIFIRE AB training are allowed to install this equipment.

Contacts

Should any part of this manual not be understood, or there are queries concerning the system, contact UNIFIRE AB Technical Support using the following details:

UNIFIRE AB, Bultgatan 40B 442 40 KUNGÄLV SWEDEN

Mail: support@unifire.com

www.unifire.com

APPROVALS AND STANDARDS

See Section 2 System Components for approval and listing information for the various components.

SAFETY warnings

A properly designed and installed FORCE 50 Robotic Nozzle should not present any significant health or safety problems. Take basic precautions to avoid accidents. The various aspects of the system's operation must be understood. Observe best practices.

! WARNING

Do not operate this device without a full understanding and comprehension of this manual. Personnel responsible for the FORCE 50 system must be fully trained on the system components.

! WARNING

The installer should pay specific attention to the danger, caution, warning, and notice statements in this manual. Failure to observe safety warnings could cause serious injury, and potentially create liability.

DANGER

Do not direct the flow stream towards people as it could result in serious personal injury or death.

- Operate and maintain the FORCE 50 Robotic Nozzle system in compliance with this document and with applicable standards, in addition to the standards of any other authorities having jurisdiction (AHJ). Failure to do so impairs the proper operation and integrity of this device.
- The owner must maintain the fire protection unit or system and devices in proper operating conditions.
- Do not, under any circumstance, operate this system outside the water flow or pressure range indicated in this manual.
- The owner must ensure that an uninterrupted supply of water is maintained to the Robotic Nozzle.

Authorized Personnel

The FORCE 50 system shall be installed by authorized personnel certified by UNIFIRE AB. Use components and accessories authorized only by UNIFIRE AB.

Structural Alterations

This installation manual details the suggested installation method. Any structural alteration necessary for installation must comply with local building code requirements.



DO NOT PRESSURIZE THE UNIT until the flange has been properly tightened.

DO NOT PRESSURIZE THE UNIT until the electrical installation and software calibration procedure has been completed

DO NOT PRESSURIZE THE UNIT until the system commissioning has been completed by certified technicians, and a formal release note / approval has been issued.





The system designer shall take into account the building construction or vehicle requirements, location, hydraulic design, coverage area, and number of systems required. If the limitations in these areas are not maintained, the system may not operate correctly.

Building Construction

• Water demand: Evaluate the FORCE 50 water system demand as an independent addition to the existing building water supply. Conduct a hydraulic analysis to ensure that it does not affect the building's existing water system design criteria. It is possible to achieve this without significant system supply modifications. However, the system may require increased pump sizes, storage tank capacity, and pipe sizes.

Determining a Location

Contact your local technical support team for assistance in determining the optimal location of the system components.

Water connection

The FORCE 50 is normally delivered with a DN50/PN16 stainless steel flange.

Options include 2" male BSP, JIS and ANSI flanges, and customer specific brackets.

Please discuss the connection with your sales representative and please specify the requested connection when ordering.



MECHANICAL INSTALLATION

INSTALLATION GEOMETRY OPTIONS

The FORCE 50 Robotic Nozzle can be installed geometrically in three different orientations:

The Robotic Nozzle can be installed with

Wall, Normal orientation Wall, Inverted orientation Ceiling, hanging orientation





Use when the water supply comes from below

Use when the Robotic Nozzle is installed on a wall, allowing a maximum of 180° horizontal and +/- 90° vertical movement .The TARGA PLC must be installed next to the Robotic Nozzle

CAUTION!

This orientation is suitable for manual operation with Joystick. This is standard geometry.

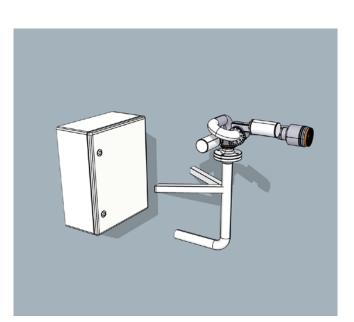

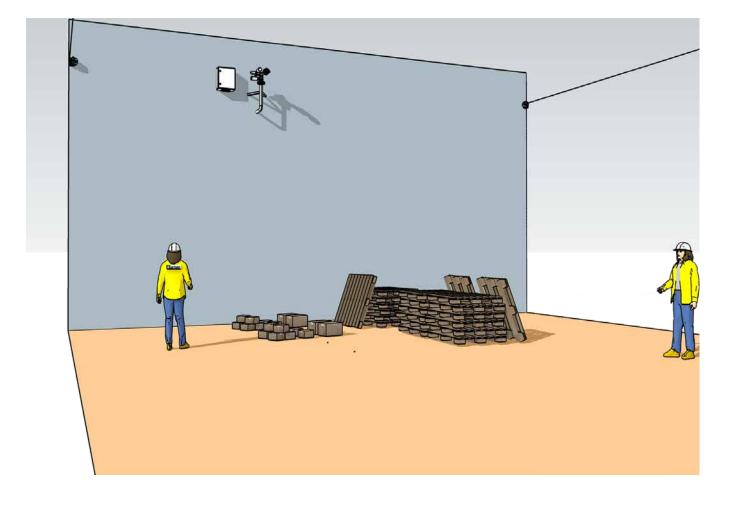

Wall, inverted orientation

Use when the water supply comes from above.


Use when the Robotic Nozzle is installed on a wall, allowing a maximum of 180° horizontal and +/- 90° vertical movement


The TARGA PLC must be installed next to the Robotic Nozzle.

This geometry is suitable for manual operation with Joystick

CAUTION!

For inverted orientation the geometry of the FORCE 50 must be inverted, hence please advise the required orientation / geometry when ordering.

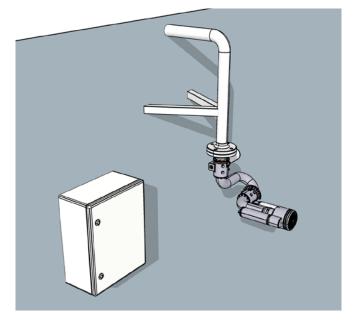

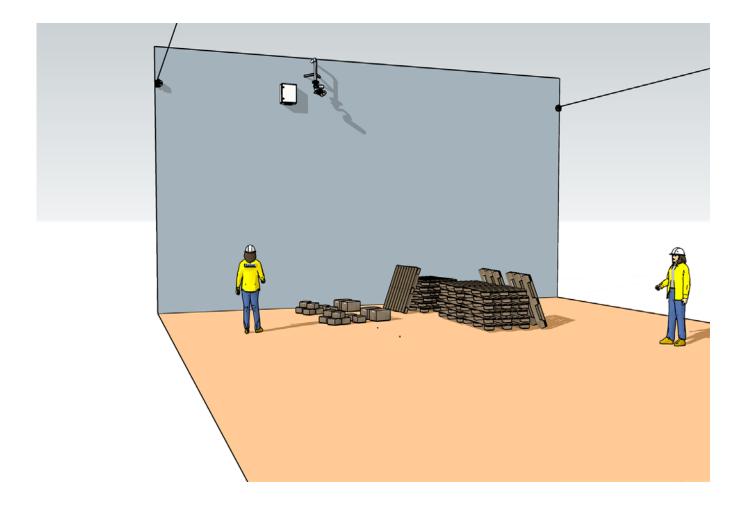

Ceiling, hanging orientation


Installing the Robotic Nozzle hanging from the ceiling usually provide the best reach and coverage.


The Robotic Nozzle can be installed in the center of the area covered by the detector, thus allowing a full 360° coverage of up to 70 m Ø (35 m reach in all directions)


This is usually the prefered orientation for autonomous systems - when the FORCE 50 is controlled from detectors or a Thermal imaging system.

This orientation is not suited for manual operation with a Joystick or the ONE App.



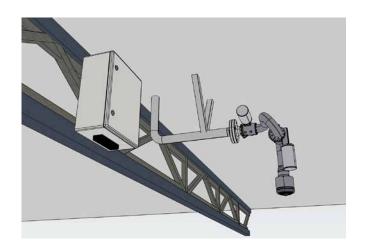

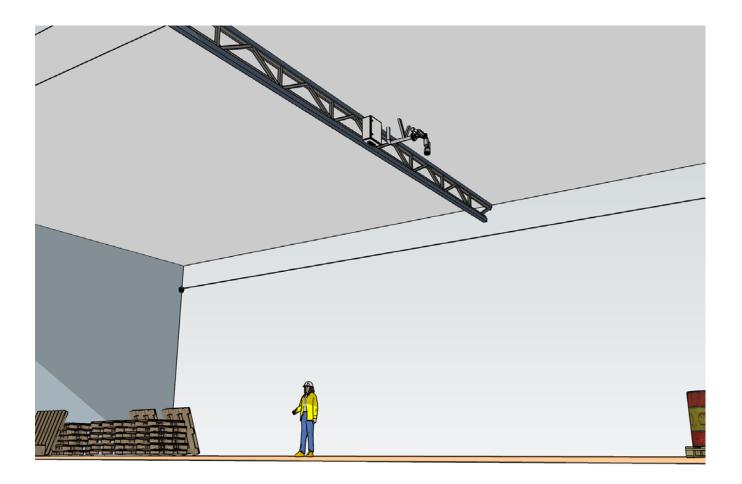


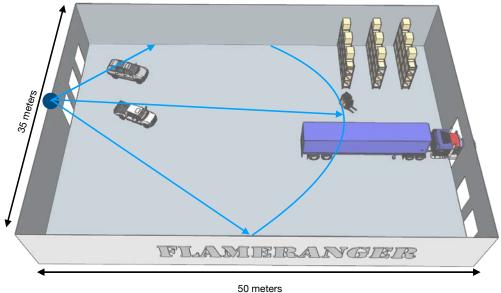

50 met

Installation on the wall

Usually provides easier access, thus it makes installation easier. The cover is limited to only 180° horizontal reach. An area of up to 40 m radius is protected. Installing on a wall provides a geometry suited for manual Joystick control.

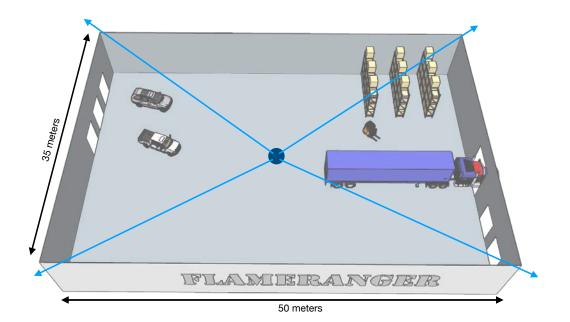

Installation hanging from the ceiling

Is recommended for fully automatic systems. It usually will provide better reach, the stream is less obstructed by objects on the floor. Up to 40 m reach provide a full 80 meter \emptyset cover. It is however difficult to control with a manual Joystick, because the geometry is rotated 90°, with the Nozzle facing straight down in default position.

Installing The Robotic Nozzle

By now we assume you have decided if the Robotic Nozzle is to be installed on the wall, or hanging from the ceiling.

The FORCE 50 Robotic Nozzle is fitted with a DN50/PN16 flange (or similar size 2" ANSI flange or JIS flange).

! WARNING

The maximum reaction force at 2000 lit/min and 10 bar is 1400 N. The mounting pipe and bracket must withstand minimum 8 000 N of Force, to provide a safe and stable base.

The flange itself provides the required support to hold the FORCE 50. Additional support and brackets must be applied to the feeding pipe to keep it stable under operation. This is especially important during fully automatic operation.

Use suitable M16 bolts and a flat seal to install the flange.

! CAUTION


Clearance!!


Take special precaution to ensure the Robotic Nozzle can move and rotate freely $+/-90^{\circ}$ in all directions


Make sure there are no obstructions with 600 mm from the centre of rotation




The FORCE 50 weighs 19 Kg incl flange and nozzle

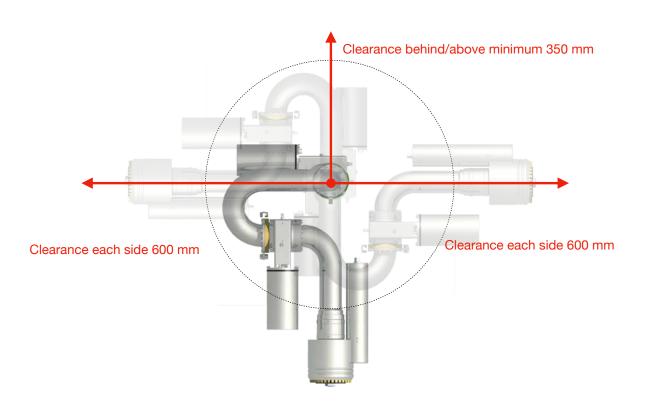

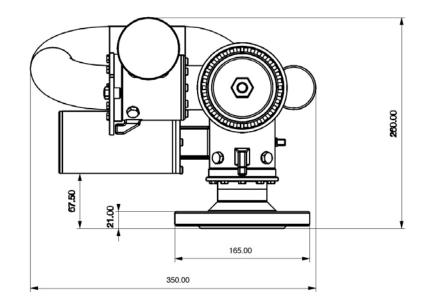

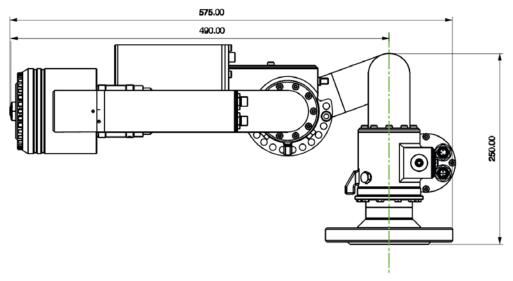

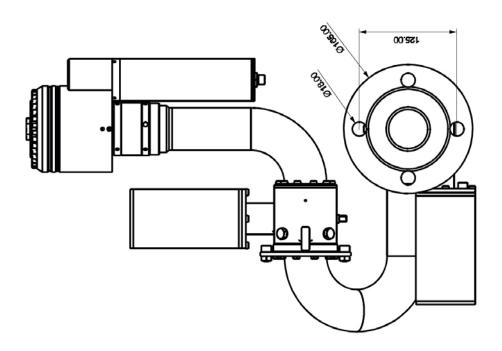

FLOW SETTINGS


Nozzle Flow Setting

The Nozzle flow can easily be selected by fitting the appropriate flow shim.

The shim is custom manufactured (3D printed) to fit each order.


Please specify your required flow at your system pressure when ordering.



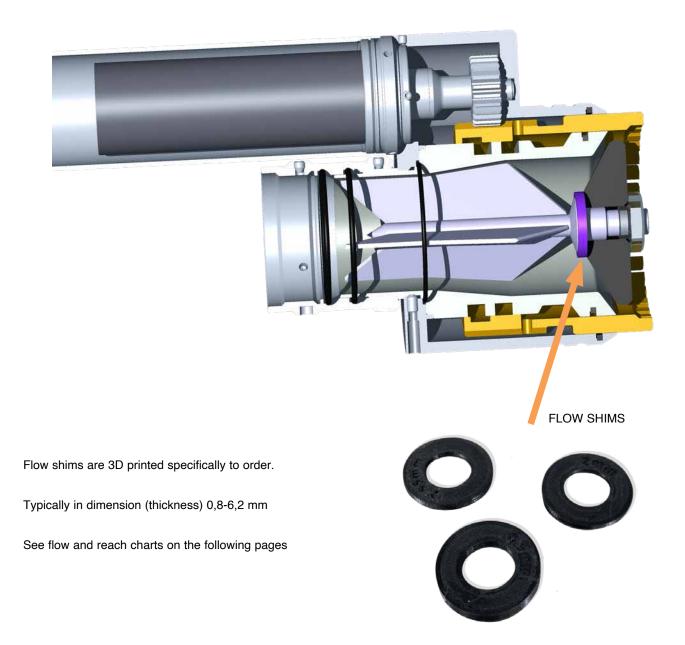


UNIFIRE FORCE 50 Robotic Nozzle Installation and setup manual

Flow chart

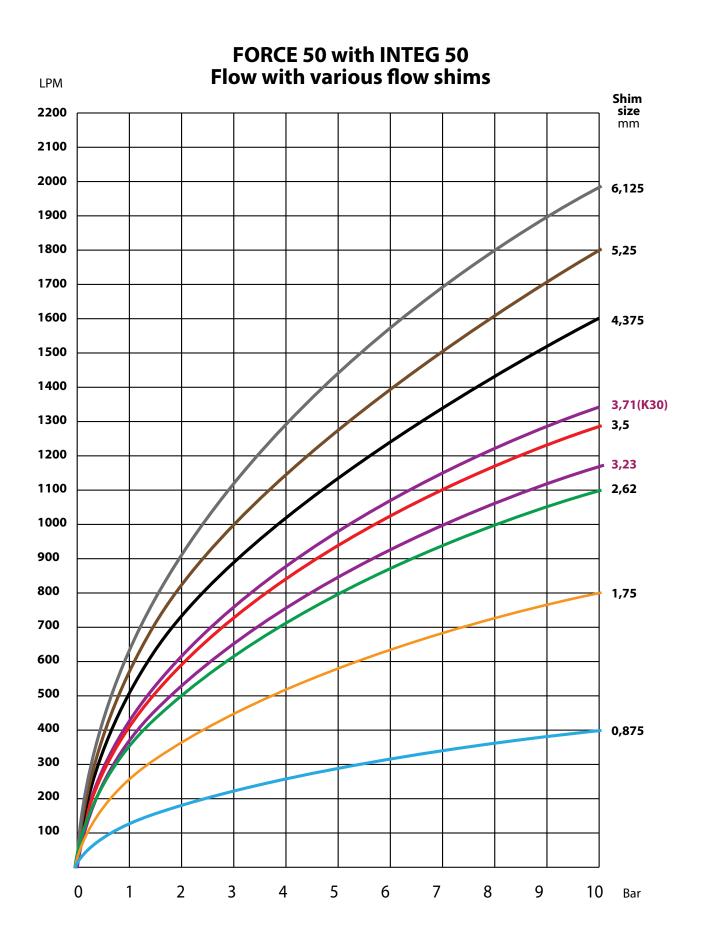

FLOW AND REACH FORCE 50 REV. 2.2 2021-02-04 5-3 UNIFIRE FORCE 50 Robotic Nozzle Installation and setup manual

Reach chart

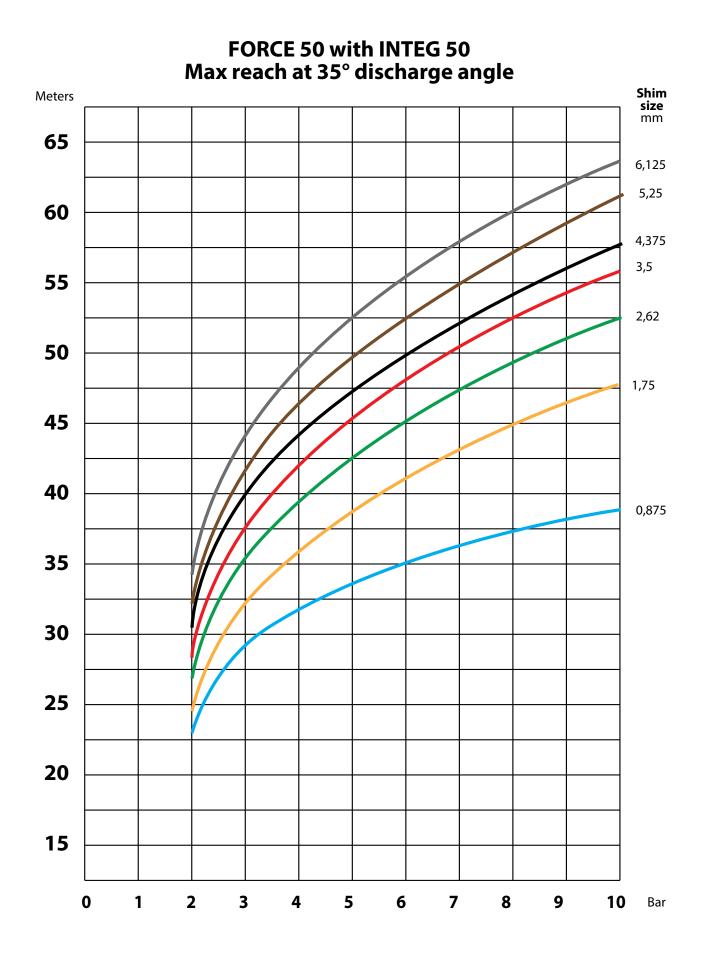





ELECTRICAL INSTALLATION

Generic system overview

The TARGA Robotic Nozzle PLC is a highly capable programmable PLC. With support for up to 6 x BLDC drivers

Communication Protocols: 2 x CAN 2.0 29-bit header (UniCAN) 125,250,500 kB/s, RS232, RS485 (Modbus, DMX, etc.)

Physical Layer Protocols: USB, Ethernet (TCP/IP, web socket), others available per customer requirements

6 BLDC Motor Driver Card Slots (optional: slots for DO or DI/AI expansion cards)

Inputs: 4 digital inputs (NPN) + 2 per installed motor driver

card, 6 analogue inputs (4-20 mA or 0-5V), expandable & customizable to customer requirements

Outputs: 8 digital outputs, of which 4 can be set to PWM.

Below is a generic example of what a system can look like.


A DHCP Router is required to set up the system with the Ammolite GUI. This will also allow for the ONE App to be activated

Over the web interface the systems can be remote controlled and remotely configured and monitored. From anywhere in the world.

A cabled Canbus Joystick can be connected for local control.

An industrial radio remote control (Hetronic ERGO-S) can also be locally connected.

Digital and analogue outputs are generic and can be used to operate valves, and send or receive status signals.

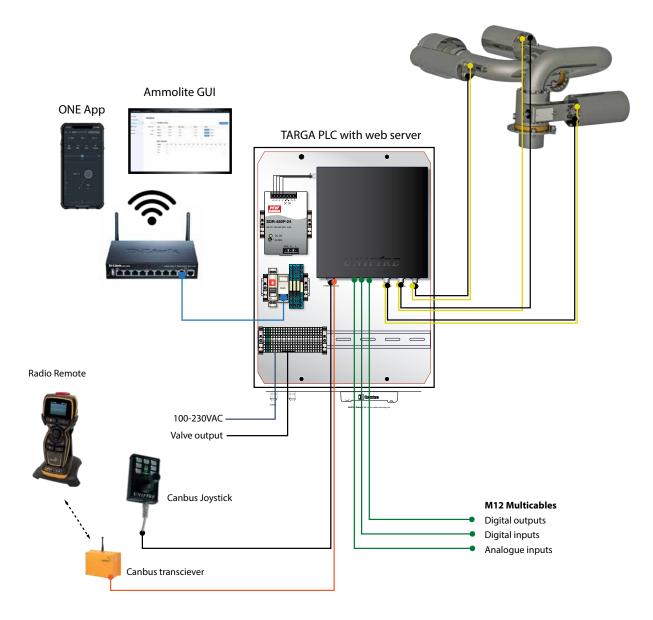

Connecting the FORCE 50 to the TARGA PLC

The FORCE 50 system is fitted with M12 multi connector. The standard system is delivered with 5-meter M12 cables

Connect the 6 x 5 meter M12 cables from the PLC to the Robotic Nozzle

From left to right: Rotation, Vertical, Nozzle


Yellow A-coded connectors are for the BLDC Motor Sensors

Black B-coded connectors are for the BLDC Motor Phases.

The key-coding makes it impossible to accidentally cross the cables.





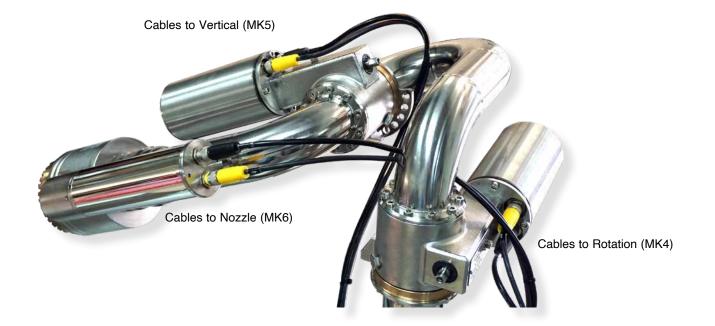


TARGA PLC generic pin-specification





5-PIN A-coded (sensors) 1 - BROWN 2 - WHITE 1


- 3 BLUE
- 4 BLACK
- 5 GREY



		_					
Joystick 5P Canbus			BLDC sensors M12 A-coded 5-pin Rotation / Vertical / Nozzle				
P1	Shield		P1	GND			
P2	24 VDC		P2	5 VDC			
P3	GND		P3	HALL 3			
P4	CAN H		P4	HALL 2			
P5	CAN L		P5	HALL 1			

4-PIN B-coded

- (phases)
- 1 BROWN
- 2 n/a
- 3 BLUE
- 4 BLACK
- 5 n/a



M12 5, 8 or 12-pin Dig In/Out			BLDC phases M12 B-coded 4-pin Rotation / Vertical / Nozzle				
P1	generic		P1	PHASE 1			
P2	generic		P2	not connected			
P3	generic		P3	PHASE 2			
P4	generic		P4	PHASE 3			
P5	generic		P5 not connected				

TARGA Robotic Nozzle PLC TERMINAL SOCKETS



RITTAL 1045500



GENERIC TERMINAL SOCKET SPECIFICATION

Terminal	Function	Function Internal External connection connection		Function	Cable mark	Cable dim.	Color marking
1	L1	L (PSU)	AC Power	Power	1	1,5 mm ²	Brown
2	N	N (PSU)	AC Power	Power	2	1,5 mm²	Blue
3	GND	GND (PSU)	AC Power	Power	3	1,5 mm ²	G/Y
4	CAN 1 H	Main board	Joystick connection box (Optional)	CAN		0,3 mm ²	Black
5	CAN 1 L	Main board	Joystick connection box (Optional)	CAN		0,3 mm ²	Grey / G/Y
6	GND	Main board	Joystick connection box (Optional)	CAN		0,3 mm²	Blue
7	VCC	Main board	Joystick connection box (Optional)	CAN		0,3 mm²	White
8	NC	Relay 1	Valve Signal	Relay	8	0,5 mm ²	
9	СОМ	Relay 1	Valve Signal	Relay	9	0,5 mm ²	
10	NO	Relay 1	Valve Signal	Relay	10	0,5 mm²	
11	NC	Relay 2	Valve Signal	Relay	11	0,5 mm²	
12	СОМ	Relay 2	Valve Signal	Relay	12	0,5 mm²	
13	NO	Relay 2	Valve Signal	Relay	13	0,5 mm ²	
14	NC	Relay 3	Spare	Relay	14	0,5 mm²	
15	сом	Relay 3	Spare	Relay	15	0,5 mm²	
16	NO	Relay 3	Spare	Relay	16	0,5 mm²	
17	NC	Relay 4	Spare	Relay	17	0,5 mm ²	
18	СОМ	Relay 4	Spare	Relay	18	0,5 mm²	
19	NO	Relay 4	Spare	Relay	19	0,5 mm ²	

SOFTWARE & CALIBRATION

Calibrating the Robotic Nozzle's operating range


Before attempting to operate, the Robotic Nozzle must be calibrated = given an operating range.

The calibration is performed through the Ammolite user interface as described in this section.

Calibrate operating range by following step 1-22 as set out on the following pages.

Wall mounted Nozzle

For wall mounted system, the origo/default position is normally that the Nozzle is pointing center (with $+/.90^{\circ}$ horizontal movement), and level to ground (with $+/.90^{\circ}$ vertical movement)

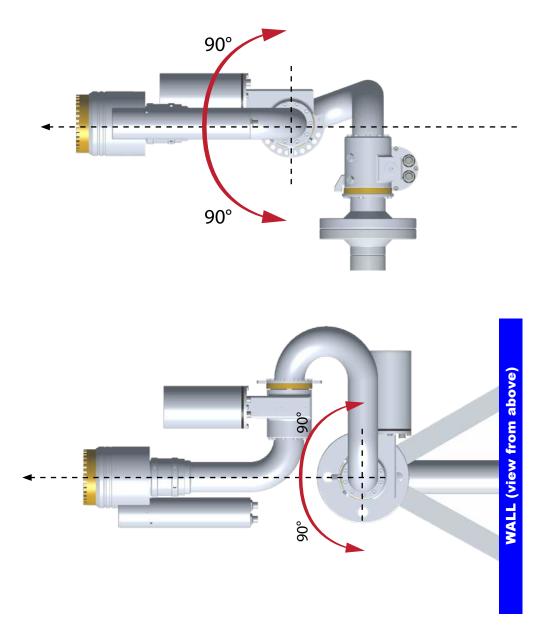

Max vertical range is +/-90° if there are no mechanical obstructions.


Max horizontal range is 360° if there are no mechanical obstructions.


Ceiling mounted Nozzle

For ceiling mounted system, the origo/default position is normally that the Nozzle is pointing **straight down on both axes.**

Please follow the step-by-step instructions on the following pages to calibrate the operating range.



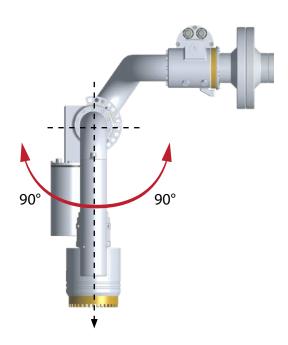

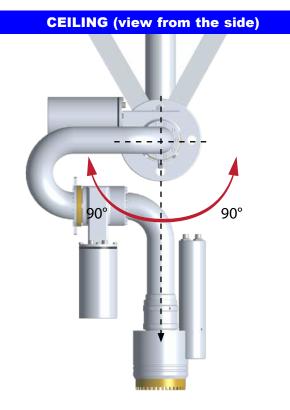

Ammolite Software Introduction

Unifire FORCE 50 set up is achieved through our web browser-based graphical user interface (GUI) called "Ammolite™

The Unifire TARGA ROBOTIC NOZZLE PLC connects to a standard TCP/IP based network. The built-in web server has been set up to be assigned an IP address by an external DHCP server. This can be a local router or a dedicated server in a larger network, administered by your IT department or similar.

To connect to the web-server, open a browser **Chrome** or **Firefox** and enter the IP address followed by :81 (ex: http://192.168.0.45:81, replace 192.168.0.45 with the actual IP).

Enter the username and password provided for your system to access the setup environment.

It is required that you make a note in the service log at login.



Connect your PC or TABLET


Connect your PC or Tablet by WiFi or cable to the same network as the TARGA PLC.


Find IP address of the TARGA PLC as automatically assigned by the DHCP server

Enter the IP address, followed by :81 in the browser window.


For example: http://192.186.0.45:81

Then follow instructions to calibrate on the following pages.

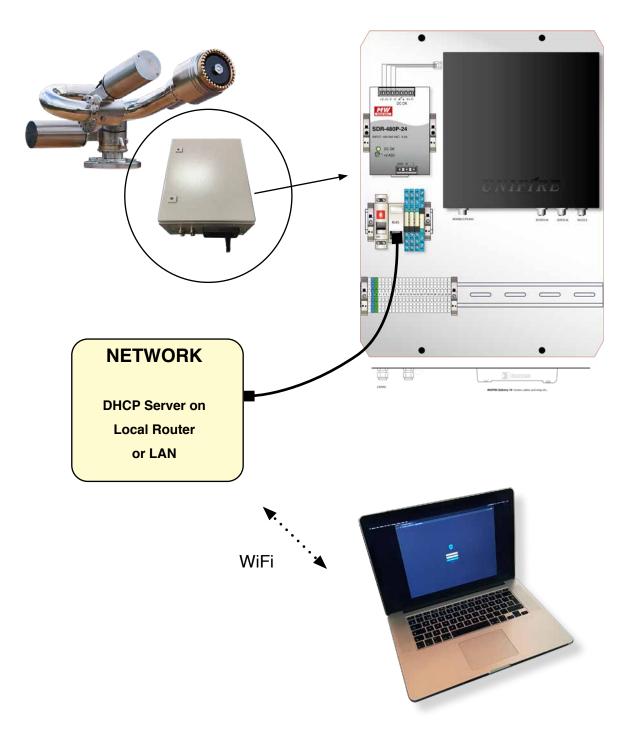


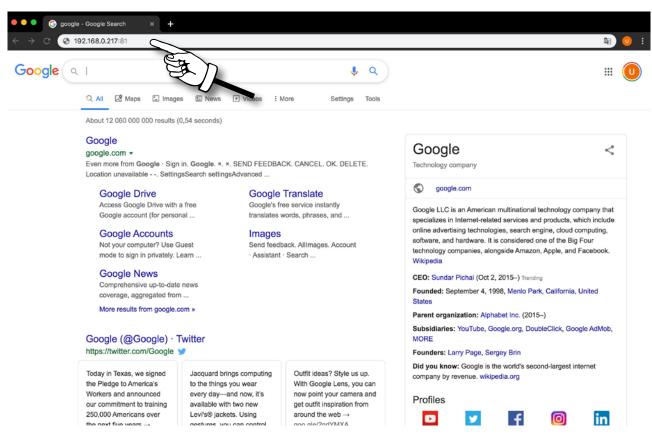


1) Open your web-browser (Safari, Chrome, Firefox or other...)

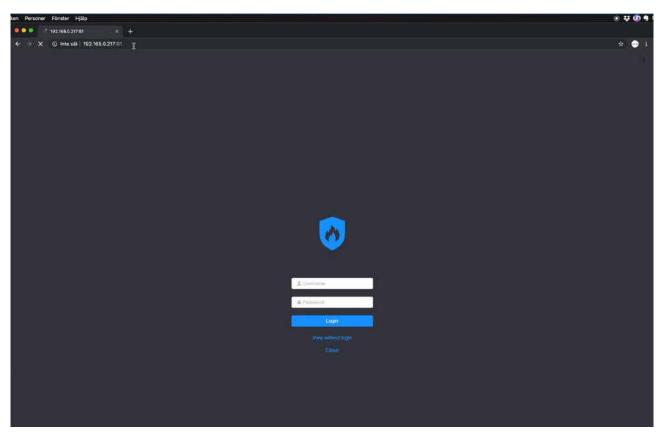

2) Enter the IP Address of the TARGA PLC, followed by :81 (for example http://192.168.0.217:81). Push Enter.

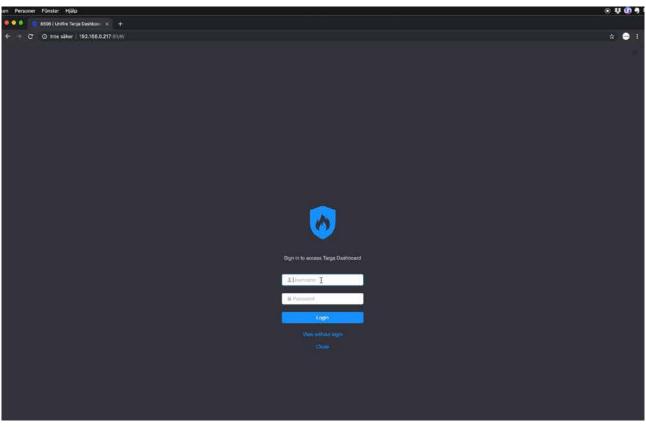

3) Enter the username and password provided with your delivery.

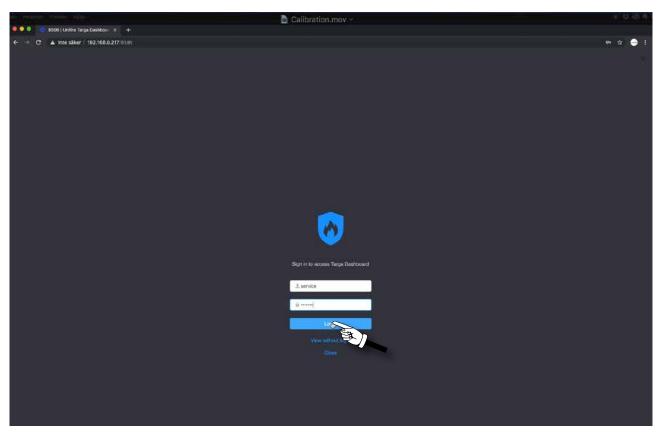

4) In this example it is "service" and "service". Click Login.

		🗟 Calib	ration.mov ~			
	ja Dashbor × + 192.168.0.217.01/m/					on sh 😑 i
Ammolite /dash	al Overview / Interfaces O Automation O	Advantasi			A 1100 1200 1000	
Service Book Procession	System overview System monitoring CPU ABIMUT Processor rev 5 (v71)	New Service Log	Ĩ		6.43.1 6.5.82 Restor Linux 70.350-edobile 309	
	Memory Rendon Access Memory Afterated Cectre 43 MB 795 MB St. 855	926 MB Total Hermony Available 105 MB 11%	Appoint Sub Appoint Processes User pid		- 806 0 806 0 Menory Proces	
	System Uptime 44 minutes		Volumes Mount A stein	Cripacity	Unage 2.206/7.305 0/45984	
	Hardware temperature		Adovalation	14	D/486M	

5) You are now requested to make a note in the service log.

		👌 Calib	ration.mov ~				
 ♦ ● ● ● 6500 Unillie Targa Destito ← → C ▲ Inte silker 192,166 							er 🛠 😁 🗄
💿 Ammolite /dash 🛛 🛁 C	Dvorview 🖌 Interfaces 🔿 Acconstitut 🔿 Acc						d and day inter
Service Book Groupses Groupses	System monitoring CPU ARM// Processor rev & (V7) Memory Tansor Access Memory	New Service Log Title Calibration Log First start-up O266 MB Calibration Available 100 MB 1115	Appcoil But Appcoil But Appcoil Processes User pid	CPU	Merrory	Rood 6.331 0.500 Robbit 7.0.35-0-ext01.6 303 800 0 800 0 800 0 800 0 800 0	
	System Uptrne 44 minutes		Volumes Maint /	Capacity		94 577.295	
	Hardware temperature		idev/ahm			ID4M	

6) So... for the example we write, "Calibration".... "First start up". Any text can be entered. Click OK.

REV. 2.2 2021-02-04 7-8

				a Calibrat	ion.mov ~					
and the second second second	irga Dashbouri x 🛛 🕂									
Total I I A MARK	192.168.0.217:81/#/									• • - 1
🗿 Ammolite /dash	A Overview / Interf	nces O Automation	n O Aovano	ed						ℜ 8508 x209 BBWC6
al System		System over	view	E.					Rebot	
Service Book Processes		System monitoring	a		System					
ia Processes		oyate in monitorini	9		Dashboard				6.43.1	
		CPU			Backand				3.5.02 Routant	
		ARM/7 Processor rev 5 (V7)			OS				Linux	
					Php 7.0.33-0+deb9u5					
					Targa Software 309					
					Nodeconf 850					
		Memory Random Access Memory 926 MB Itrail memory		Sub Nodeconf 0						
				Appcont 8506						
			6 MB	Sub Appcont				0		
			Tarya	memory	Processes					
		Allocated	Cached Available	Available	User	pid	CPU	Memory	Process	
			795 MB							
		5%	86% 11%	11%						
				~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~				NO CIDE		
					Volumes					
		System Uptime 44 minutes		Mount		Capacity		Usage		
					<u>(</u>				2.2G/7.2G	
					/dev				07459M	
		Hardware temper	ature		/dev/shm				0 / 464M	
					10 March 10				4000 C 400 40 4	

7) This opens up the start page of Ammolite. To initiate calibration of the operating range, click "Advanced".

et Parent March				🙆 Calibration.mov 🗠			· ● ● 目 ●						
tree constraints constraints	re Targa Deshbolili 🗙 🛛 4												
	iker   192,168.0.217:81/					• ☆ ⊖ 1							
🔕 Ammolite /dash	Josephiew and the second secon	🖌 Interfaces	O Automation	© Advanced			31 8536 × 1309 Service						
O Settings	1												
* Configuration		Set	tings										
(2) Hardware Co.		1	Bystem settings	Timezone									
E Firmware	N			Change timezone on this Targs	Europe / Parie								
		N	Vetwork settings	Time & Date									
1 Users				Change Date and Time on this Targa	2019-10-04 11:09:21	Ċ.							
A Debug Y				Hostname									
				Targa display name on network (Needs restart)	8508								
				Save 1									

8) This opens up the section Advanced settings. Next click "Hardware".

#### SOFTWARE & CALIBRATION FORCE 50

REV. 2.2 2021-02-04 7-9


🔹 🔍 💼 8505   Unifire Tar	nga Dashibos X +				<b>D</b> C	alibrat	ion.mo	ov ~												
	192.168.0.217-51/#/advanced/hardwa																			. 🔿
Ammolite /dash	🖬 Overview 🖌 Interfaces	O Automati	on O Adva	inced														Å	0500 × 1009	. sento
Ø Settings	На	rdware																		
* Configuration																				
(2) Hardigans		Maters	Available r	notors												01	fest motors			
Firmware		Card	Po	Position			Max Position			rent		Actions								
1 Users		Typically: Horizontal	Motor 4	15			152				10 A		Galibrate	Fixpos						
賽 Debug ····		Vertical	Motor 5	24	é		2044			0.0	10 - A		Calibrate	Fixpos						
		Motor 6 524				524			0.00 A			Calibrate	Fixpos	Fixpos						
			Motor state	uses																
			SlotBit	0	0	0	0	0	0	0	0	0	0	0	0	0	6			
			MK 4				10			185		4	•				•			
			MK-5 MK-6	- X.		14 12	1.00					14	-							
			MR 0		5		1	÷.			- 5		•			÷.				

9) This open up the Motor page. You can read the position of the motors, calibrated max, actual real time current draw (A), and Motor Status.


MK4 is usually horizontal, MK5 usually vertical, and MK6 usually nozzle jet/spray)

Actions					
Actions			_		
Actions					
Actions				> Teet motors	
Calberte	Fixpos	ś.			
Canter					
Calibrato	Fapos		6		
0	0	0	0	0	
	*	- 14	43	*	
		1	13		
			÷.	(1)	
	0	0 0	0 0 0	0 0 0 0 * *	0 0 0 0 0


REV. 2.2 2021-02-04 7-10

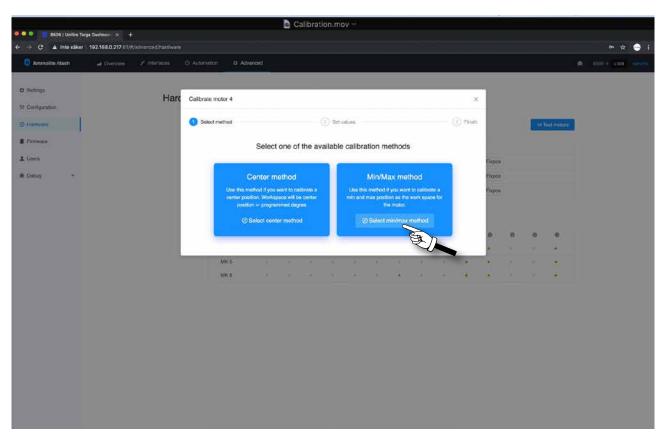

11) Select Min/Max method that allows you to freely select any operating range. (Center method is used only for special applications when the operating range is preset in the software)

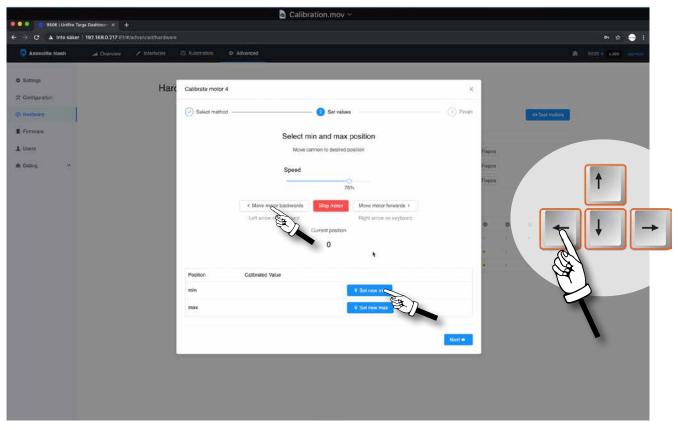

12) Run the motor to the required Min position (left arrow), by using either the buttons on the screen (for tablets), or using the right/left arrow key on your PC Keyboard. Once you have the position, Click "Set new min"

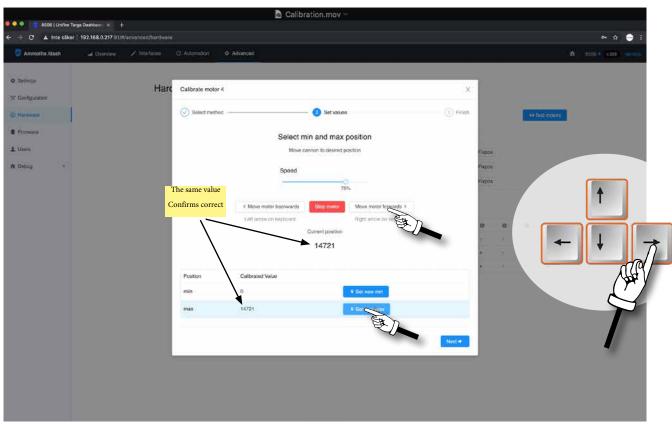

13) Run the motor to the required Max position (right arrow). Now the "Current position should read a value typically between 2 000 and 50 000. Click set new Max.

🛢 🛇 🎍 📑 8506 i Unifire Targ	ga Dashtouri X +					C C	alibrat	tion.mo	ov ~													
← → C ▲ Inte sliker		dvanced/herdware																			•	
C Ammolite /dash	at Overview	🖈 Interfacion	Ø Actomation	O Adva	noed														<b>A</b> 1101	+ 9.309	1.1100	-
D Settings															-							
St Configuration		Harc	Calibrate m	iotor 4										×								
2 Hortware			Select n	nethod				🕑 Set v	alons —				-	3 Finish				Teat motors				
Fraware					New m	in and	max	osition	has be	en cal	ibrated											
A Users															Fixpos							
A Dooug -								✓ Close							Fixpee							
				Motor 6	- 27	6		574			1818	C. 74		CHONN	Fixper							
				Motor stat	uses					b.												
				Skullar	0	6	0	8		8	ø	0	0	0	0	8	0	0				
				MICH.																		
				MK5.																		
				ыка										*								

14) Next, you see this notice, confirming successful calibration.


REV. 2.2 2021-02-04 7-12


	- Overview / Interfaces © /	Automation O Adva	nced														ΩE 8	505 <b>- 4.30</b> 9	
Settings	Hardwa	re																	
Configuration																			
Haritware	Mate	ers Available n	notors												െ	fest motors	() I		
Firmware		Card	P	osition		Max Pos	ition		Cur	terit		Actions							
Users		Motor 4		1721		14721				0 A		Calbrate	Fixpos						
Debug v		Motor 5	2	45		2044			0.0	10 A		6.46	Fixpos						
		Motor 6	5	24		524			0,0	ю А		Celoret	E)	2					
													-0						
		Motor state	ises																
		SloftBit	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
		MK.4	12		31						1			1	11				
		MK 5	÷.	-	4							•	•		-	•			
		MK 6	+ .		1		- C		•		. +	•			+	•			

15) Repeat steps 10 - 15 for Motor 5 (vertical)

Ammolite /dash	🖬 Overview 🖌 Interfaces	O Automation	O Advan	red														ġ.	8506 V.209	
	A CVOLICH A MICHAELES	O Postinación																ж	0.000 0.000	300
Settings																				
Configuration	Hard	dware																		
Hardware		Maters	Available m	notors												.01	ast motors			
Firmware			Card	P	osition		Max Pos	ition		Gurr	rent		Actions							
Users			Motor 4	3	4721		14721			0.0	6 A		Galibrate	Popos						
Deoug			Motor 5	2	4.8		11434			0.0	6 A		Calibrate	Fixpos						
			Motor 6	1	3721		13721			0.0	0 A		Callorana	Fixpos						
			Motor statu	ses																
			SlorBit	0		0	0	0	٥	0	0	0	0	۰	0	0	0			
			MK 4	1.0	- C	3	(*)	- C		14.		2	1.4		4					
			MK S	1	τ.	7	12.5		2	2.1		7	*	•	4		•			
			MK 6			4	1011	÷						•	-1	4	•			

16) Calibrate Motor 6 (nozzle jet/spray) in the same manner as you did the other motors, but follow the instructions in step 17 on the next page

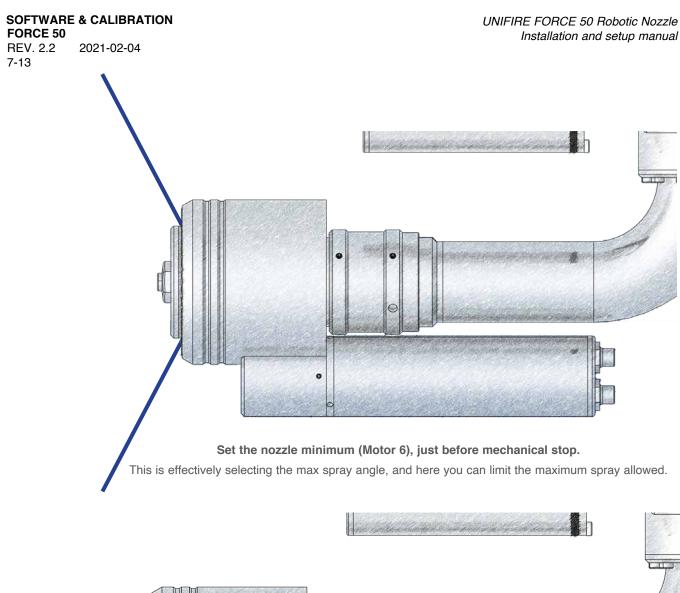

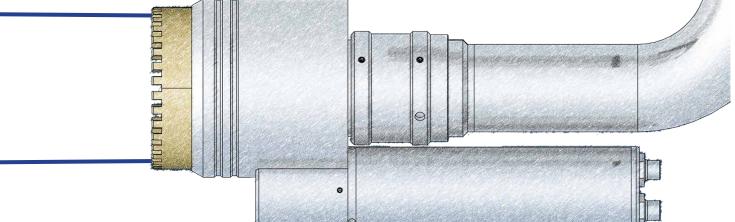

Set nozzle maximum (Motor 6), just before mechanical stop.

This is effectively selecting the straight stream.

Here you can block the straight stream by setting the

Maximum to - say - 10 ° spray, and thereby avoid a straight steam.

This is useful when the required reach is short, and you want to avoid a hard-hitting straight steam all together.

17) Calibrate Motor 6 (jet/spray nozzle) as Motor 4 and Motor 5

7-14

Settings	Hardv	vare															
onfiguration	5	Available	motore												_		121
ardwara	,	Available	motors												•	Teel days	ET
imwaro		Card	P	osition		Max Pos	ition		Cun	tent		Actions				Ę	
sors		Motor 4	1	4721		14721			0.0	A 01		Calbrate	Fixpos				
obug ~		Motor 5	2	46		11434			0,0	0 A		Calbrate	Fixpoa				
			1	3721		13721			0.0	A 00		Galbrahi	Fixpos				
		Motor sta	atuses														
		SlofvBit	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
		MK 4	÷.		1	100	÷.	a.	(e)		14	¥.	•	14	έŝ.		
		MK S	1.0	10 A	2	1.41	1	3	1.00	- 21	2		•	3	- 11 	•	
		MIK 6		2	1		1	5		2	2			1	- S		

18) Next you can test the motors and calibrated range directly form your PC. Click "Test motors".

			n O Advar	resd			Test Mot	ors													
Settings	Hard	ware							Umte	d mode							Infin	ity mode			
Dectiguration							Colast m	notors to tes													
Haldware		Motors	Available m	notors			Select n	iolors to tes	54												
Eumware			Cald	Posts	m	Max Posts		Skt	Po	ation		Max Pos	tion		Cu	rrent		Keype	iir		
Users			Motor 4	1473		14121		MK 4	14	21		14721			0.	ooTa		Loft	Right		
Debug 🛩			Motor E	248		13434		En												Et.	T
			Motor 6	1372		13723		MRO	-	1		11434			0.	00 A		Left	Right	21	
								MK 6	13	721		13721			0.	D0 A		Loft	Right		
			Motor statu	ses																	
			SkotkBit	0	0. 6	. 0	Go to fix	pos													Refeat
			мк-і			5.		Fapos 1			Fog	09 2			Fo	xpos 3			Fi	xpos 4	
			MKE																		
			MK C			10 A	Motor St	of inter													
							New York, Gr														
							Siof\Bit	0	0	0	0	0	0	0	0	0	0	0	0	0	0
							MK 4		¥.	13	91) 1 1		e			(8) 777	10		18	P.	
							MK 5 MK 6		÷	-	-	-	-	÷		1.0	•	-	-	-	-
							MK E				*.	4				. *		•			

19) Check the box for each motor you want to run.

Ammolite /dash	al Overview 🖌 Interfaces 🔿 Autor	usion O Adv	anced			Test Mo	tors													;
D Sotlings								Linite	ed mode	67						Intie	ity mode			
Contegutation	Hardware							Linna	our moor								iy nou			
o mentere	Mators	Available	motors			Select n	notors to tes	t												
Firmwara		Card		Position	Max Posi		Slot	Po	sition		Max Po	notifier		Cu	creat :		Keypa	ie:		
Users		Motor 4		14723	14723		MK 4	14	721		14721			0.	A 00		Lett	Right		
Debug		Motor 5		248	(11834)												Lari	- agent		
		Motor #		12723/:	43724		MK 5	24			11434			0.	A 00		Upl	Down		
						2	MK 6	13	121		19721			0.	00 A		Lett	Right o	1	
		Motor stat	tuses												/	~	Ange	N ROYE	C.	n
		Sicren		0		Go to fo	kpos						/	/				Down		
		MK-4				-	Fixpos 1			F0	pos 2	/		Fo	ipos 3		Lette	ft Right	64	
		MK.S				Var	need to			/								E 😓		
		MIC (E						/									A	100	ъ	
						choose.	Left Righ	t									W	s		
						SlotBit	0				0				8		Z) Ø	8		0
						MK 4														
						MK 5	- C.	5	1	5	12	-	1	3 2	-				1	
						MK 6					141				1	÷				1
						NON D		- C-	-		1.	121		-		-				

20) Then actively choose key pair. (This must be done.)

	ga Dashbosi 🗙 🕂					<b>a</b> c	alibra	tion.mov															
C A inte säker     Ammolite /dash	192,168.0.217.61/#/m	dvanced/hardwar	<ul> <li>O Automatio</li> </ul>	n <b>O Adva</b>	anood				Test Mot	ors												e 1	a €
) Settings		Har	dware								Limi	ted mod	ò						inti	nity mode			
Configuration			Motors	Available r	motors				Select m	otors to tes	st												
Parroware										Slot	Po	osition		Max P	osition		0	urrent		Keypa	ie.		
Users				Card		oction		Max Positi	-												-		
Debug				Motor 4 Motor 5		4721 859		14721		MK 4	14	6721		14723	L		0	A 00,		Loft	Flight		
P.5014 220				Motor 6		1658		13721		MK 5	35	152		11434			0	.31 A		Upt	Down		
										MK 6	- 11	1658		13721	í.		0	.04 A		0 E			
				Motor stat	uses				Go to fix	pos													Re
				MK 4	1					Fixpos 1			_	opos 2				topos 3				xpos 4	
				MKS				100		Papes 1				opos z			4	octore a			-10	xpos 4	
				MCD.				141	1.0000000														
									Motor St	atuses													
									Slot/Bit	0	0	0	0	0	0	0	0	0	0	0	0	0	
									MK 4	<i>e</i>		1		¥.		4		1	4	•			
									MK 5											1			
									. Interest														
																t	100						
) Now you	ı can run	the mo	otors w	vith the	e sel	ecte	d ke	ey pai	r.					+		ţ		ו	+				

SOFTWARE & CALIBRATION FORCE 50

REV. 2.2 2021-02-04 7-16

Ammolite /dash	J Overview / Interfaces (© Autor	ation O Aqua	in the second				Test Mo	lote												112 12	نثر
Animeter venem	A Orderican S research C action		incuo .		_		lest Mo	ors													7
Saminga									1.000	ited mod	a						Infin	ity mod			R
K Cookguration	Hardware									ille ille o	2							19 1190	9		8
-	Marcal	Available i	notors				Select r	notors to te	st												1
Emain								Slot	P	osition		Max P	osition		C.	urront		Кеура	air		
L Upens		Cand		noifico/		Max Positi	1														
		Motor 4		1732		LATEL		MK 4	1	1735		14721			0.	A 90.		Left	Right		
A Debug Y		Motor 5 Motor 5		32û 792		13434	2	MK 5	ł	320		11434			٥.	00 A		Up	Down		
		And the second		(0a)			77.5	100000													
		Motor stat	uses					MK 6		792		13721			0.	00 A		QE			
		SlotEit	0	0	.0	0	Go to fo	rpos													Release
		M05 #						1403057			12				. 22						
		MK 5				5		Pixpus 1			-	ixpos 2			n	xpos 3				xpos 4	
		MK G				×1.															
							Motor S	tatuses													
							SlohBit	0	0	0	0	0	0	0	ø	0	•	0	0		0
							MK-4	1.0		14	10	1.0	÷.	(62	4		14		- 14	÷	
							MK 5			24		181		.00				1.5	12	15	
							MK 8			1	- h-	191	4		2		12			à.	

22) Calibration is now complete and you can exit Test Motors and Ammolite.



# TECHNICAL SPECIFICATIONS SYSTEM COMPONENTS



# FORCE 50 QUICK SPECIFICATIONS

**2" ROBOTIC NOZZLE** 

Max Flow: 2100 liters (555 gallons) per minute; 126 m3/hr

Туре:	Remote Controlled	
Material:	Stainless Steel 316L	
Range of Motion:	360° rotation / 180° vertic	al movement
Base Connection:	2" Male BSP or flange (AN	NSI, DIN, JIS)
Nozzle Tip Connection:	2" Male BSP	
Motor Type:	24V Brushless DC (BLDC	)
Certificates:	Bureau Veritas (BV) Type Manufactured at ISO 900	
	Metric	Imperial
Int. Pipe Diameter:	50 mm	2" inches
Dimensions (w/ Integ nozzle):	25 x 35 x 58 cm	9.8" x 13.8" x 22.8" inches
Weight (w/ Integ nozzle):	19 kg	42 lbs
Max. Flow:	2 100 lpm	555 gpm
Max. Reach:	65 meters	71 yards
Max. Working Pressure:	12 bar	174 psi
Nominal Operating Pressure:	10 bar	145 psi

# FORCE 50 - DETAILED SPECIFICATIONS

ITEM / FEATURE	DESCRIPTION
Force 50 BLDC Robotic Nozzle Chassis:	2" electric 24V brushless motor (BLDC) robotic nozzle (a.k.a. "remote control monitor" or "water cannon") suitable for fire fighting.
	Made of 316L Stainless Steel (EN1.4404).
	Robust and suitable for harsh environments.
	Compatible with use of foam, salt-water, and oth- er harsh agents.
	Smooth, large (50mm) pipe bends for minimal friction loss.
	Fully integrated and enclosed stainless steel worm gears, with Bronze (CuSn12) gear wheels.
	Fully enclosed BLDC brushless motors provide extremely long life, high torque and allow ex- tremely accurate positioning and position feed- back.
	Modular design for capability of changing dam- aged pipe sections and gear housings.
	Very low-maintenance; never requires re-greas- ing.
	Mass: Approx. 12.5 kg without nozzle tip.
	Dimensions (w/ Integ nozzle): 25 x 35 x 58 cm.
	Ambient temperature range: -25°C to +70°C.
Flow Range:	500 to 2100 liters (130 to 555 U.S. gallons) per min- ute; ; 126 m3/hr) Integ 50 jet/spray tip is mechan- ically adjustable to accommodate various flows. JETRANGE 50 tip has interchangeable flow discs to meet your flow requirements
Max Working Pressure:	12 bar
Nominal Operating Pressure:	10 bar
Maximum Reach:	Approximately 65 meters at 2000 liters per min- ute at 10 bars (71 yards at 530 gpm at 145 psi) in jet stream mode. Actual results can vary signifi- cantly depending on a number of factors (wind, piping, valves, pump, etc.)
Maximum Range of Motion:	360° horizontal; 180° vertical (+/- 90° from hor- izontal). Range can be easily set to any range desired. (May be limited if used with POINTER controller to 270° horizontal / - 20°/+ 70° or other custom specification. Inquire to learn more.)
Movement Velocity (Speed):	Standard: 24°/sec. rotational; 12°/sec. vertical Optional High Speed: up to 70 or 360 °/sec.



# **TARGA™ PLC SPECIFICATIONS**

### Unifire's Revolutionary PLC for Total System Control

Models:	TARGA1, TARGA2, TARGA3, TARGA4, TARGA5 & TARGA6 (digit represents # of installed BLDC driver cards)
Power:	24V DC / 20 Amps
Weight:	1 kg / 2.2 lbs
Dimensions:	225 x 225 x 125 mm / 8.9" x 8.9" x 5" inches
Communication Protocols:	2 x CAN 2.0 29-bit header (UniCAN) 125.250.500 kB/s, RS232, RS485 (Modbus, DMX, etc.)
Physical Layer Protocols:	USB, Ethernet (TCP/IP, web socket), others available per customer requirements.
BLDC Motor Driver Card Slots:	6 (each with 2 digital inputs)
Inputs:	4 digital inputs (NPT) + 2 per installed motor driver card, 6 analogue inputs (4-20 mA or 0-5V), expandable & cus- tomizable to customer requirements
Outputs:	8 digital outputs, of which 4 can be set to PWM, ex- pandable to customer requirements
Connector Types:	M12 A/B coded, 4P, 5P, 8P, 12P
Certificates:	CE Marked, Manufactured at ISO Certified facilities.

# TARGA PLC DIMENSIONS



**X-TARGA** 

**X-TARGA-S** 





RITTAL IP66 Steel Plate Cabinet Weidmüller IP67 Stainless Steel cabinet

# X-TARGA[™] & X-TARGA-S

# Unifire's Revolutionary, Industrial & Marine PLC for Total System Control


The X-TARGA is Unifire's revolutionary TARGA PLC (Programmable Logic Controller), mounted in one of two choices of IP66 cabinets, both designed for the harshest environments and power supply from 110 to 230 V AC at 50 or 60 Hertz., for the total, flexible control of Unifire's advanced robotic nozzle systems and a virtually-endless variety of other system peripherals and components. The unique TARGA system allows users to simply and economically tailor water cannon systems to their individual needs. From basic, low-cost, stand alone installations, to highly sophisticated and integrated systems.

Both cabinet types are IP66 rated and designed for the harshest environments, both on- and off-shore. The X-TARGA comes standard with a built-in power converter from 110 to 230 V AC at 50 or 60 Hertz to TARGA's native 24VDC / 20 Amp requirement. The mounted TARGA (see TARGA section of this brochure) is a scaleable system platform that supports up to six BLDC motors and numerous analogue and digital inputs and outputs. The Unifire X-TARGA PLC controller for robotic nozzles, valves, lights, peripherals, automatic systems, system integration, and much more.

2019 technology allows our customers to control systems from their phone, tablet and computer, from anywhere in the world. Network systems together and control from a central control station, and even monitor the system status, learn of any component failures, and upload system software updates or system function changes requested from Unifire.

# X-TARGA(-S) PLC SPECIFICATIONS

Models:	X-TARGA & X-TARGA-S (each followed by a number 1-6. rep- resenting the quantity of installed BLDC driver cards)
Power Input:	110/230 V AC, 50/60 Hz (built-in converter to 24VDC / 20 Amps)
Approximate Weight:	15 kg / 33 lbs.
Cabinet Types:	Model: X-TARGA: RITTAL IP66 Steel Plate cabinet type: AE 1045.500, Dimensions: 500 x 400 x 210 mm / 19.7" x 15.8" x 8.3" inches, mass: 13 kg.
	Model: X-TARGA-S: Weidmüller IP67 Stainless Steel cabinet type: KTB MH 453820 S4E1 Stainless Steel 316L Cabinet, Di- mensions: 458 x 382 x 200 mm / 18" x 15" x 7.9" inches, mass: 11.54 kg.
Communication Proto- cols:	2 x CAN 2.0 29-bit header (UniCAN) 125,250,500 kB/s, RS232, RS485 (Modbus, DMX, etc.)
Physical Layer Protocols:	USB, Ethernet (TCP/IP, web socket), others available per cus- tomer requirements
BLD Motor Driver Card Slots:	6 (each with 2 digital inputs)
Inputs:	4 digital inputs (NPT) + 2 per installed motor driver card, 6 analogue inputs (4-20 mA or 0-5V), expandable & customiz- able to customer requirements
Outputs:	8 digital outputs, of which 4 can be set to PWM, expandable to customer requirements
Connector Types:	M12 A/B coded, 4P, 5P, 8P, 12P
Certificates	CE Marked, produced at ISO 9000 and 14000 certified facili- ties
Max altitude	Never install the X-TARGA PLC over 4000 meter above sea level

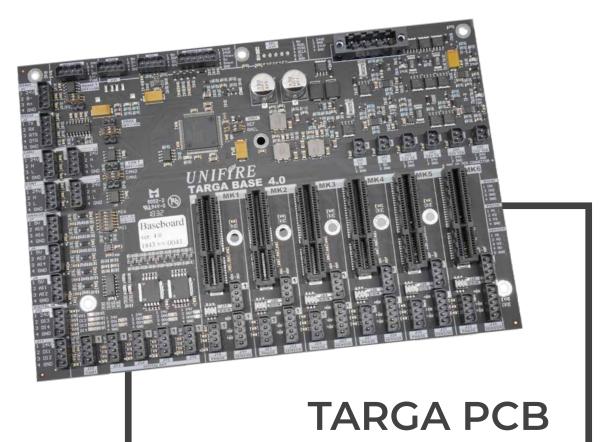

# **Unifire TARGA PCB**

Many PLC's (programmable logic controllers) are commercially available on the market, and are used by many of Unifire's competitors.

But Unifire won't settle for standard, off-the-shelf solutions. At Unifire, we think for ourselves. And, we are very demanding.

Commerically-available PLC's are bulky, designed to suit a wide variety of industries and applications, and are therefore over-loaded with bulky electronics, components and software, markedly reducing efficiency, and often failing to include key features Unifire demands for its advanced systems.

That is why Unifire has spent years maticulously designing and improving our own TARGA PCB (printed circuit board), tailor-made for our robotic nozzle systems and their peripherals, and to accommodate technologies yet to come. Our newest generation PCB is cutting-edge technology and provides a huge range of possibilities, accommodates rapid, dynamic technological advances, maximizes efficiency in hardware and software design, and is the perfect solution for total control of our robotic nozzle systems.


Manufactured for Unifire in Sweden at ISO 9001 & 14001 certified, stateof-the-art facilities, side-by-side with electronics for Ericsson, SAAB Space, Volvo, and other industry-leading, highly demanding companies.

When quality matters, look to Unifire.

### Features

The Unifire TARGA PCB is laoded with features, including, to name a few:

- 6 BLDC Motor Driver Slots for the control of brushless motors
- A variety of communication protocols, including 2 x CAN 2.0 29-bit header (UniCAN) 125,250,500 kB/s, RS232, RS485 (Modbus, DMX, etc.
- USB, Ethernet (TCP/IP, web socket), others available per customer requirements
- 4 digital inputs (NPT) + 2 per installed motor driver card,
- 6 analogue inputs (4-20 mA or 0-5V), expandable & customizable to customer requirements
- 8 digital outputs, of which 4 can be set to PWM, expandable to customer requirements
- Reserved control pins, allows to work with other control boards
- Comes with development resources and manual (examples in wiringPi/ python)

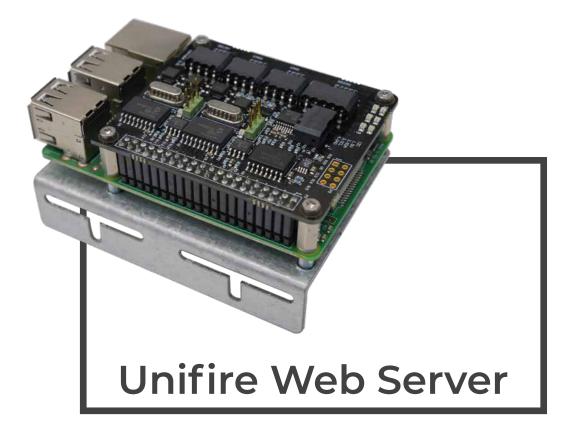

Take Complete Control Of Unifire's Robotic Nozzle Systems From Anywhere In The World, Thanks To Our Web Server— A Full-Blown, Internet-Ready Pc, Built In To Our Targa Plc, That Fits In The Palm Of Your Hand!!

Welcome to the Internet of Things!

The Unifire Web Server is our optional, full-functioned personal computer (PC) add-on to our entire line of TARGA PLC's.

The Unifire web server, combined with our CAN Bus Cape, allows all models of Unifire's TARGA PLC's to come fully online.

Thanks to the Unifire Web Server, our customers have the option of taking full, secure control of Unifire's advanced robotic nozzle systems with our InterAct software and app.

Have a phone? Control our systems. Have a tablet? Control our systems. Have a computer? Control our systems. Got Internet access? Control our systems from anywhere in the world!

### Features

The Unifire Web Server is a key component of Unifire's InterAct system. Combined with our CANbus Cape. USB Router and InterAct software and Graphical User Interfacess, adds to Unifire's advanced robotic nozzle systems a host of networking and control capabilities, including over the Internet.


Unifire's already powerful and flexible InterAct graphical user interface can be custom designed to your specific needs, look, functionas, language and look, with virtually unlimited flexibility to control systems with advanced logic sequences and automated functions.

# Specifications

- SOC: Broadcom BCM2837B0, Cortex-A53 (ARMv8) 64-bit SoC
- CPU: 1.4GHz 64-bit quad-core ARM Cortex-A53 CPU
- RAM: 1GB LPDDR2 SDRAM
- Operating system support: Linux and Unix
- WIFI: Dual-band 802.11ac wireless LAN (2.4GHz and 5GHz ) and Bluetooth 4.2, capable of running at 2.4GHz and 5GHz.
- Ethernet: Gigabit Ethernet over USB 2.0 (max 300 Mbps)
- Thermal management: Yes.
- Power over Ethernet
- Video: Yes VideoCore IV 3D. Full-size HDMI
- USB 2.0: 4 ports
- Power: 5V/2.5A DC power input

"Here's to the crazy ones. The misfits. The rebels. The troublemakers. The round pegs in the square holes. The ones who see things differently. They're not fond of rules. And they have no respect for the status quo. You can quote them, disagree with them, glorify or vilify them. About the only thing you can't do is ignore them. Because they change things. They push the human race forward. And while some may see them as the crazy ones, we see genius. Because the people who are crazy enough to think they can change the world, are the ones who do."

— Apple Inc.

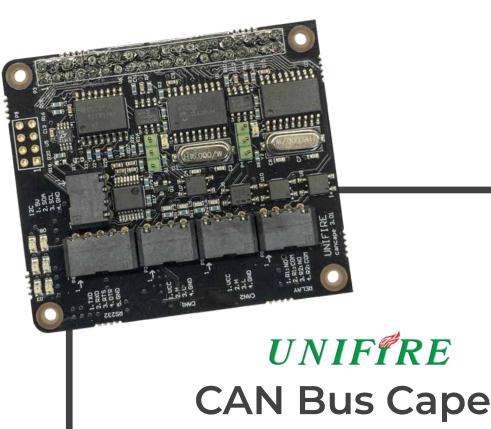

### Unifire CAN Bus Cape for Raspberry Pi

### Communication Hat with 2x CAN, RS232, I²C and relays.

### **Technical Overview**

The Unifire CAN Cape adds serial networking options to your Raspberry Pi utilizing the GPIO.


The two onboard CAN Bus ports utilize the Microchip MCP2515 CAN controller, accessible per SPI interface, in combination with the Microchip MCP2551 CAN transceiver. 120Ω termination is available by jumper or control over GPIO.

The RS232 port is controlled via the RPi's UART using the MAX3232 linedriver and receiver.

The I²C is buffered by LTC4313 and the two onboard photoMOS relays allow for simple digital control of external equipment. The IO expander for the I²C bus allows for even further expansions.

Onboard is also a DC/DC transformer allowing the CAN cape to supply the RPi with power. PoCAN (Power over CAN) makes this possible.

The CAN cape is also equipped with six blue LED indicators.

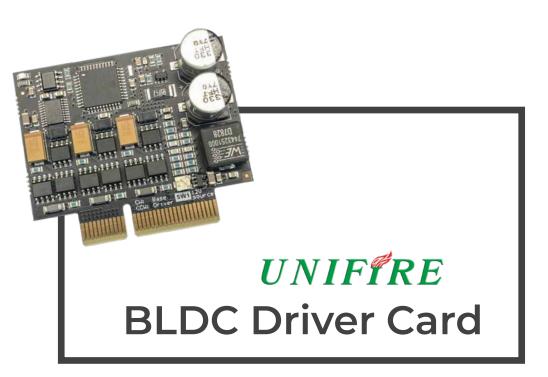

### Unifire BLDC Motor Driver Card

Like all of our electronics, Unifire designed its own BLDC motor driver card to deliver the functionality and efficiency unique to Unifire's robotic nozzle systems.

Unlike competing solutions, Unifire uses 3-phase 24V DC brushless (BLDC) motors to control its robotic nozzles. These are the same motors used in numerous industrial robots — and for good reason. BLDC motors offer numerous advantages over standard, "brushed" DC motors used in most competing products., such as higher torque, higher precision in their control, and much longer life.

Controlling BLDC motors, however, requires special electronics to precisely control the three phases sent to the motors. That's where Unifire's unique BLDC motor driver cards come in.

With Unifire's BLDC motor driver cards, our customers benefit from the highest precision steering and control of any robotic nozzle on the market —with an accuracy over over 1/50th of a degree.


# **UNIFIRE** ONE Graphical User Interface

# **ONE** App for iOS & Android

**The First & Only Robotic Nozzle Control App on the Market**, **ONE** is Unifire's revolutionary, full-functioned graphical user interface & virtual joystick for iOS & Android, available for free on Google Play Store and Apple iPhone App Store.



# **ONE** App for iOS & Android

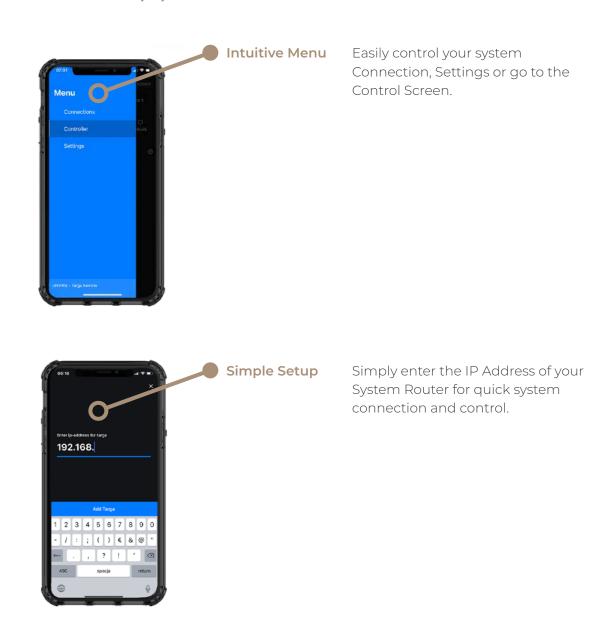

With Unifire's InterAct core technology and our ONE app, you no longer need a joystick.

For a fraction of the price of our competitors' tethered and wireless joysticks, you can turn any device into a powerful wireless controller. And, it's easier to use and comes loaded with more functions than most competing controllers!



# Welcome to 21st Century robotic nozzle system control!



# $\pi^{TM}$ (Pi) CAN bus Joystick

# CAN bus Progressive Speed, Full-Featured Joystick

Unifire's  $\pi$  (Pi) Joystick is Unifire's versatile, full-functioned, hand-held joystick for precise and intuitive control of Force robotic nozzles. Our most popular controller, it is robust and water resistent, with numerous features.

# **Specifications:**

- Multifunctional CANbus joystick
- Intuitive, progressive speed control
- · 3-Axis control (horizontal, vertical, nozzle)
- Nozzle spray pattern controlled by dial on tip of joystick shaft
- Record / Play Record any sequence including velocity changes, pauses, & nozzle spray pattern. Play back in a continuous loop.
- Programmable park (stow) function
- LED Position Indicators for relative horizontal, vertical and nozzle positions
- Valve Control Button
- 2 auxiliary buttons for custom configuration & control of peripherals (e.g., lights).
- Up to 500 meter cable supported
- Hand-held
- Weighs only 1 Kg



Seriously Heavy duty!! All chrome plated brass and stainless steel. Butter-smooth action. Massively supportive when the

# **POINTER™** Synchron Joystick

# Synchronized Movement of POINTER and Robotic Nozzle

The POINTER is Unifire's unique, synchron control device designed to provide a simple and intuitive human interface for controlling the Unifire's robotic nozzles.

The robotic nozzle's movements exactly follow and match the position of the POINT-ER.

The base is fitted with potentiometer to provide exact position values to the TARGA PLC, which in turn aim the robots to exactly the same horizontal and vertical angles as the POINTER. The hand-grip has a trigger switch at the front. The switch has a spring return. The switch will be connected directly to the vehicle's discharge valve. The water is discharged when the trigger is held, and stops when the trigger is released.

### **Specifications:**

- 142 x 130 x 70 mm (above the panel into which it is mounted)
- Material: Chrome plated brass base; heavy duty plastic grip cover on a 4 mm stainless steel plate
- 5-pin M12 connector connect to the TARGA PLC
- · 3-pin M12 connector to route the trigger button to discharge valve control
- Standard rotation range: +70°/-20° vertical, 270° horizontal
- Scroll wheel option for progressive jet/spray nozzle tip control



# **BLDC Motors**

### & Complete Motor Can Assemblies

### **Motor Features**

Where our competitors are still using run-of-the-mill "brushed" DC motors (which have been used since 1856), Unifire alone is blazing new trails by outfitting all of our robotic nozzles with industrial-robot-type brushless DC (BLDC) motors.

Brushless DC motors have no brushes to get worn out, they have significantly higher efficiency and performance, and a lower susceptibility to mechanical wear than standard brushed motors. Some of the other advantages include:

- Higher torque to weight ratio
- · Increased torque per watt of power input (increased efficiency)
- · Increased reliability and lower maintenance
- · Reduced operational and mechanical noise
- Significantly longer life span (10 000 operational hours)

Although it is highly unlikely to ever require replacing a BLDC motor in our robotic nozzles, we do stock and can supply spare motors and complete motor can assemblies with motors pre-assembled for simple, quick replacement.

# FORCE 50 SPARE PARTS



### Force 50 Complete Worm Gear Assembly

Complete worm gear assembly with gear wheel, gear screw, bearings, and O-ring. Connected to the pipes by flange assembly.

#### Part Number.: FOR50200

### **Complete BLDC Motor & Welded Cover**

BLDC Motor in threaded stainless steel cover, for quick and simple motor replacement.

Part Numbers.: BLDC84S (Verticlal motor assembly) BLDC49S (Horizontal motor assembly) 1621962: BLDC with 49:1 Gear Ratio 1621963: BLDC with 84:1 Gear Ratio





# Force 50 Front Pipe Section

Front pipe section for the Force 50, with stream straightenr and 2" BSP male thread outlet for nozzle tip connection.

Part Number.: FORCE50-PS1

# Force 50 Middle Pipe Section

Force 50 middle pipe section with flange connection with  $10 \times (M5x16)$  at both ends.

Part Number.: FORCE50-PS2



TECHNICAL SPECIFICATIONS FORCE 50 REV. 2.2 2021-02-04 8-19

# **Custom Solutions**



Horizontal Swing Arm



Vertical Swing Arm



**Automatic Doors** 



Flange Connection



Vehicle Side Turret



**Telescopic Pipe** 



**Custom Radio Remote** 



Force 50 Rail Mount



Force 80 Rail Mount

Unifire offers a variety of piping mounts, swing arms, automatic doors, special vehicle solutions (including touchscreen computer controls) and other custom solutions.

Pictured above are just a few examples. If you have special requirements, contact us for more information.